



HVAC Service Technician Advanced

Student Codes: 7907 and 7797 / Version: 01
Teacher Code: 9157 / Version: 01
Copyright © 2009. All Rights Reserved.

General Assessment Information

Blueprint Contents

General Assessment Information
Written Assessment Information

Specific Competencies Covered in the Test
Sample Written Items
Performance Assessment Information

Test Type: This certification assessment is a customized assessment for the Home Builders Institute. This assessment measures technical skills at the occupational level and includes items which gauge factual and theoretical knowledge. This assessment offers both a written and performance component and can be used at the secondary level and postsecondary level. This assessment can be delivered in an online or paper/pencil format.

Revision Team: The assessment content is based on input from secondary, post-secondary, and business/industry representatives from the state of California, Florida, Indiana, Michigan, Mississippi, New York, North Dakota, Texas, Virginia, and Washington.



47.0201 – Heating, Air Conditioning,
Ventilation and Refrigeration
Maintenance Technology/Technician



Career Cluster - Architecture
and Construction



49-9021.01 – Heating and Air
Conditioning Mechanics
and Installers



The Association for Career and Technical Education (ACTE), the leading professional organization for career and technical educators, commends all students who participate in career and technical education programs and choose to validate their educational attainment through rigorous technical assessments. In taking this assessment you demonstrate to your school, your parents and guardians, your future employers and yourself that you understand the concepts and knowledge needed to succeed in the workplace. Good Luck!



The Home Builders Institute (HBI) trains skilled workers for the building industry. Through pre-apprenticeship training, certification programs and job placement services, HBI provides graduates with the skills and experience they need to build a career and change their lives. HBI assessments, in partnership with the National Association of Home Builders (NAHB), are based on national skills standards set by industry professionals and educators. Participants passing the assessments are eligible for certification through HBI/NAHB at the entry, semi-skilled, or skilled levels.

Selection of curricula and instructional materials chosen to support assessment achievement must be obtained from material that has been aligned to the Residential Construction National Skill Standards and approved by HBI. For a current listing, please go to <http://www.hbi.org/curriculum/>

Visit www.hbi.org for more information.

Written Assessment


This written assessment consists of questions to measure an individual's factual theoretical knowledge.

Administration Time: 90 minutes

Number of Questions: 100

Number of Sessions: This assessment may be administered in two sessions.

Areas Covered

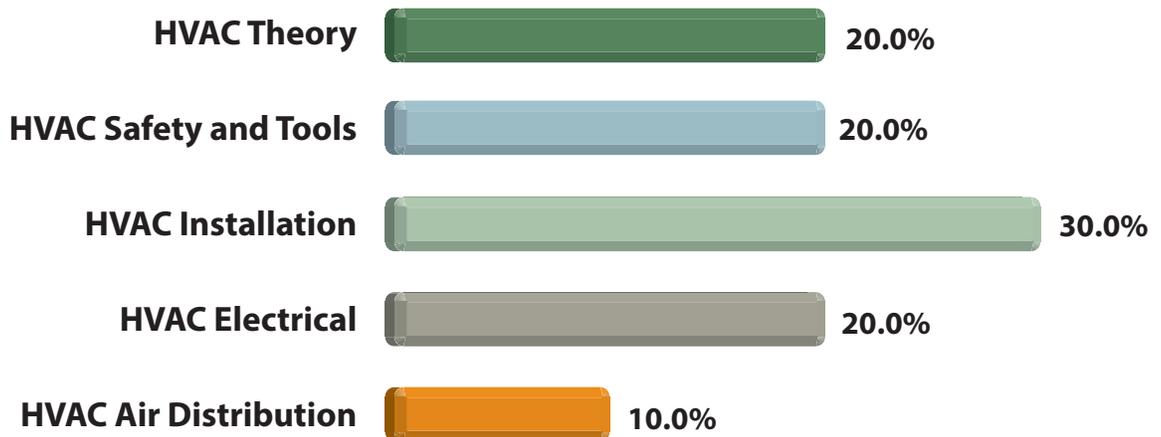

Specific Competencies and Skills Tested in This Assessment

HVAC Theory

- Heat Theory and Refrigeration

HVAC Safety and Tools

- Safety and Tools

HVAC Installation

- Electric, Gas, Oil, Hydronic, Heat Pump, and Geothermal Installation

HVAC Electrical

- Controls, Motors, and Troubleshooting

HVAC Air Distribution

- Air Treatment and Installation



Sample Questions

Which of these illustrates conduction?

- A. Heat transferred from a hot water baseboard heater
- B. Heat transferred by the sun's rays
- C. Heating water in a pot
- D. Heating air by forcing it through an evaporator coil

What is the minimum size of a drain line if the unit is equipped with a 1-inch female pipe thread connection?

- A. 1 - inch
- B. 3/4 - inch
- C. 1/2 - inch
- D. 3/8 - inch

A heat pump that starts the defrost cycle by temperature is most likely equipped with which of these?

- A. Thermistor
- B. Pressure-sensing switch
- C. Defrost timer
- D. Time delay relay

A 120-volt power supply is feeding a 30-ohm resistive strip heater. How much current is flowing in the circuit?

- A. 4 amperes
- B. 8 amperes
- C. 36 amperes
- D. .25 amperes

Which of these is used to seal fiberboard duct systems?

- A. Canvas collars
- B. Self-tapping screws
- C. S-type connectors
- D. Reinforced foil tape



Performance Assessment

This performance assessment allows individuals to demonstrate their acquired skills by completing actual jobs using the tools, materials, machines, and equipment related to the technical area.

Administration Time: 3 hours and 30 minutes

Number of Jobs: 2


Areas Covered:

40% Gas Furnace Start-up and Check

Evaluation of assigned order, leak test gas connections, test supply gas pressure, test electric connection for voltage and polarity, start equipment, adjust thermostat heat anticipator setting, test manifold gas pressure, test temperature rise through unit, check fan motor amperage draw, perform steady state efficiency test, complete system operation sheet, time to complete job.

60% Air Conditioning

Evaluation of assigned order, remove unit panels and service caps, wire low voltage control circuit, verify no voltage on all wires, test capacitors, perform compressor checks, check line voltage upstream of disconnect fuses, close disconnect, check line voltage downstream of disconnect fuses, verify and record line voltage at the condensing unit, perform transformer terminals check, measure fan motor common leg amperage, calculate CFM, connect refrigeration gauges and purge air, record/correct/convert pressures, check suction line temperature at evaporator outlet, check/diagnose liquid line drier, evacuate line set and indoor coil, charge refrigerant into system, perform system check, check voltage at air handling unit/heat strips, check heat strips current draw, check dry bulb temperature rise, verify heating/cooling to specifications/enthalpy chart, reinstall unit panels and service caps, time to complete job.

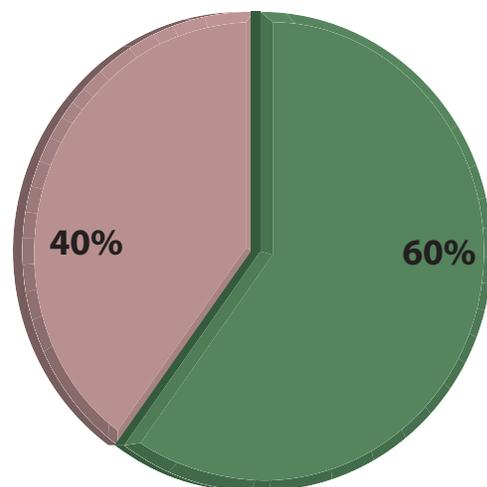

Sample Job

Gas furnace Start-Up and Check

Maximum Time: 1 hour and 30 minutes

Participant Activity: Following the instructions provided, the participant will perform start-up tests on a high efficiency (90 +) gas furnace. The participant will make the necessary adjustments to meet manufacturer's specification for proper operation and perform a steady state efficiency test.

